


# INSTALLATION INSTRUCTIONS MODELS TS-6, TS-7, TS-8, TS-9



U.L. FILE SA32686

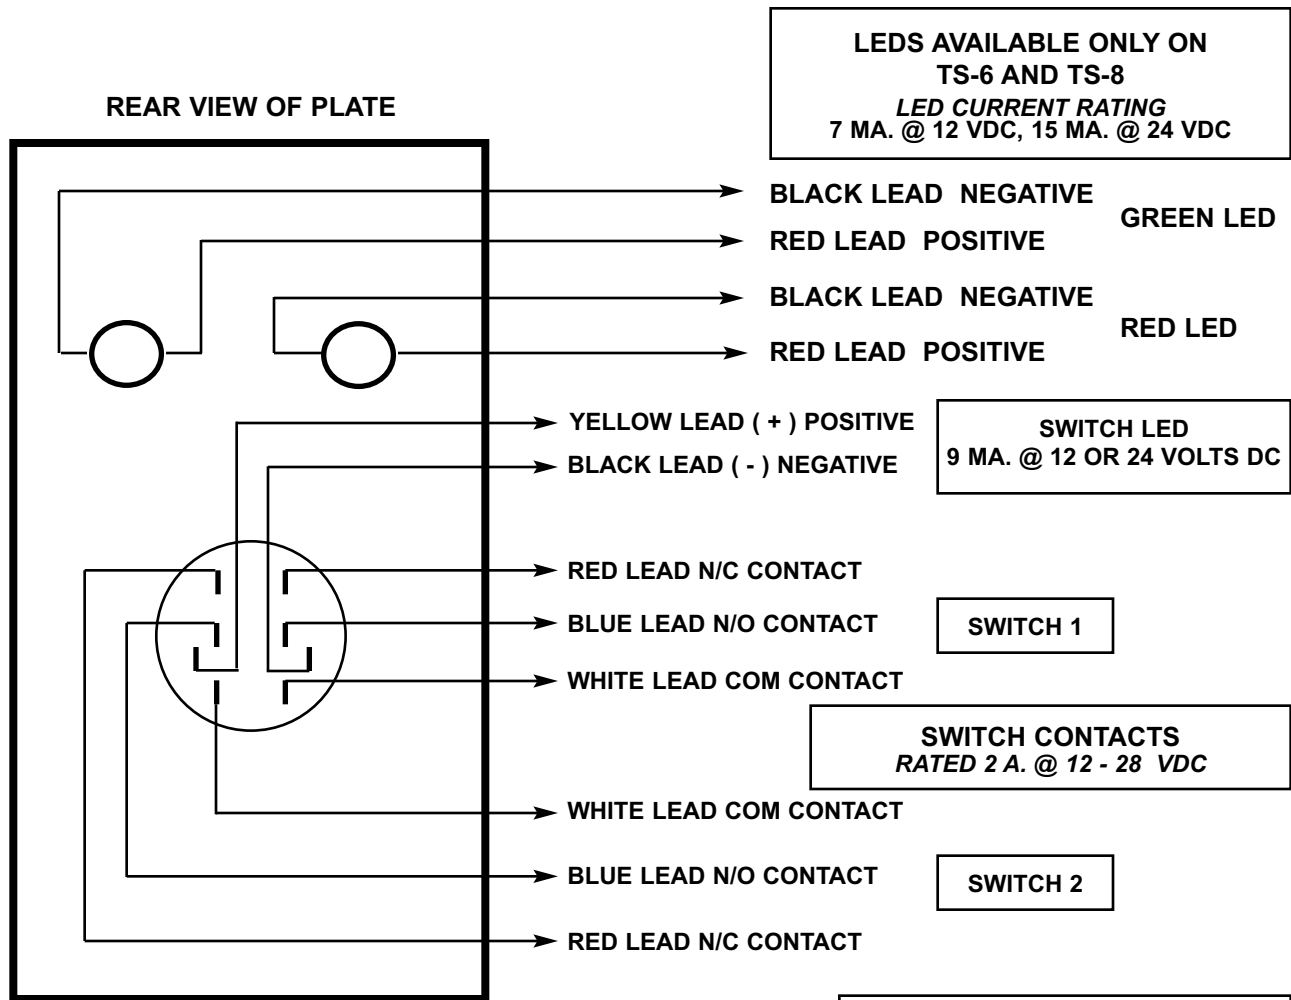

**MOUNT WALLPLATE  
IN A VERTICAL POSITION**

MODELS TS-6, TS-7, TS-8 & TS-9  
SHOULD BE MOUNTED IN A  
2.5 INCH DEEP ELECTRICAL BOX

**FOR 24 VOLT SWITCH LED  
OPERATION**

ADD 1000 OHM 1/2 WATT RESISTOR  
IN SERIES WITH YELLOW LEAD.  
INSULATE RESISTOR TO PREVENT  
SHORTING.



**ALARM CONTROLS CORPORATION**  
19 BRANDYWINE DRIVE P.O. BOX 280  
DEER PARK, NY 11729

PH: 1 800 645-5538 1 631 586-4220 FAX ; 1 631 586-6500  
WWW.ALARMCONTROLS.COM EMAIL: INFO@ALARMCONTROLS.COM